



DEPRESSED CURB
FOR DRIVEWAY
(3/4" MAX. LIP)

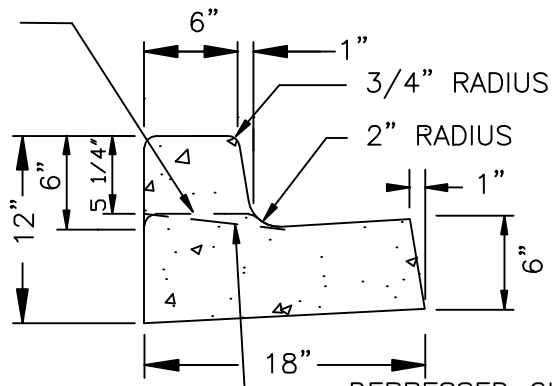

DEPRESSED CURB FOR WHEELCHAIR RAMP
2% MAX.SLOPE

TYPICAL CURB & GUTTER

DEPRESSED CURB
FOR DRIVEWAY
(3/4" MAX. LIP)

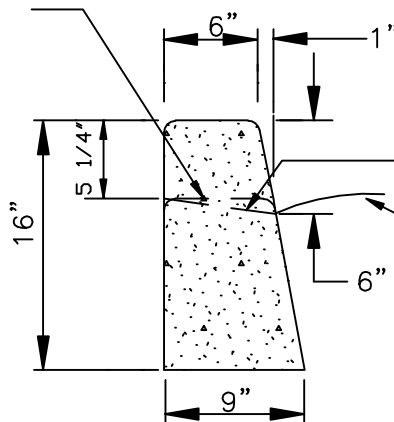


DEPRESSED CURB FOR WHEELCHAIR
RAMP (2% MAX SLOPE)
PAVEMENT

TYPICAL STRAIGHT CURB


NOTES:

1. ALL RADII SHALL BE 3/4" EXCEPT AS OTHERWISE SHOWN.
2. ISOLATION JOINTS SHALL BE PLACED ONLY AS SPECIFIED.
3. CONTRACTION JOINTS SHALL BE PLACED AT 15' INTERVALS UNLESS OTHERWISE SPECIFIED, AND SHALL EXTEND AT LEAST 50% THROUGH THE CURB OR CURB & GUTTER.
4. A CONTRACTION JOINT SHALL BE PLACED ALONG AND OVER WEEP HOLE THROUGH THE CURB AND THROUGH THE SIDEWALK.
5. WHEN SIDEWALKS ARE CONSTRUCTED, EXTEND 3" PIPE TO BACK OF SIDEWALK AND INSTALL COUPLING.

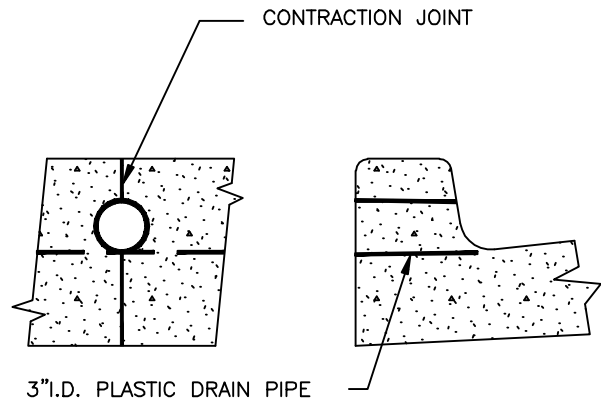

3" I.D. PLASTIC DRAIN PIPE

WEEP HOLE THROUGH CURB

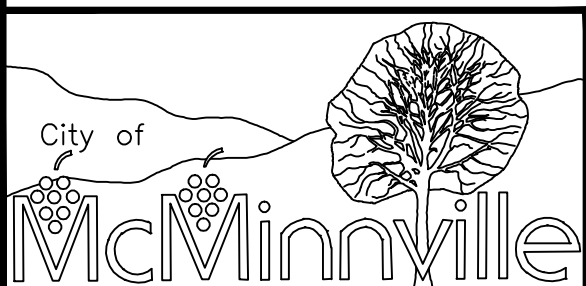

DETAIL FOR P.C. CONCRETE CURB AND GUTTER

DATE:

AUGUST 2009

DRAWING NO.

6